



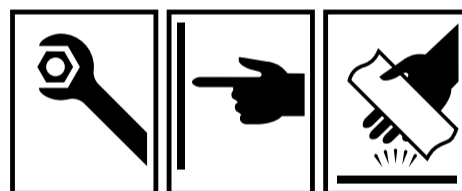

Ordering spares / Ersatzteil - Regelung / Pièces de rechange / Parti di ricambio / Lista de recambios / Onderdelen bestellen (NL/B) / Κωδικοί Ανταλλακτικών / Bestilling af reservedele / Beställning av reservdelar / Bestilling av reservedeler / Резервни части / Запчасти / Części zapasowe / Piese de schimb / Rendelhető alkatrészek / Запасні частини / Резервни делови / Резервни делови / Atsarginių dalių / Tellitavad varuosad / Rezerves daļas / Náhradní díly / Náhradné diely / Yedek parça siparişi / Nadomestni deli

XX = AA, AD,


- 1 - B 961721 XX
- 1a - B 961720 XX
- 2 - A 961157 XX
- 3 - A 861446 NU
- 4 - A 861247 NU - RH
- 4a - A 861246 NU - LH
- 5 - A 961625 XX
- 6 - B 960486 XX
- 7 - B 960167 XX
- 8 - A 960944 NU
- 9 - B 961171 XX
- 10 - B 960471 NU
- 11 - A 963173 NU
- 12 - B 1364 XX
- 13 - B 960925 XX

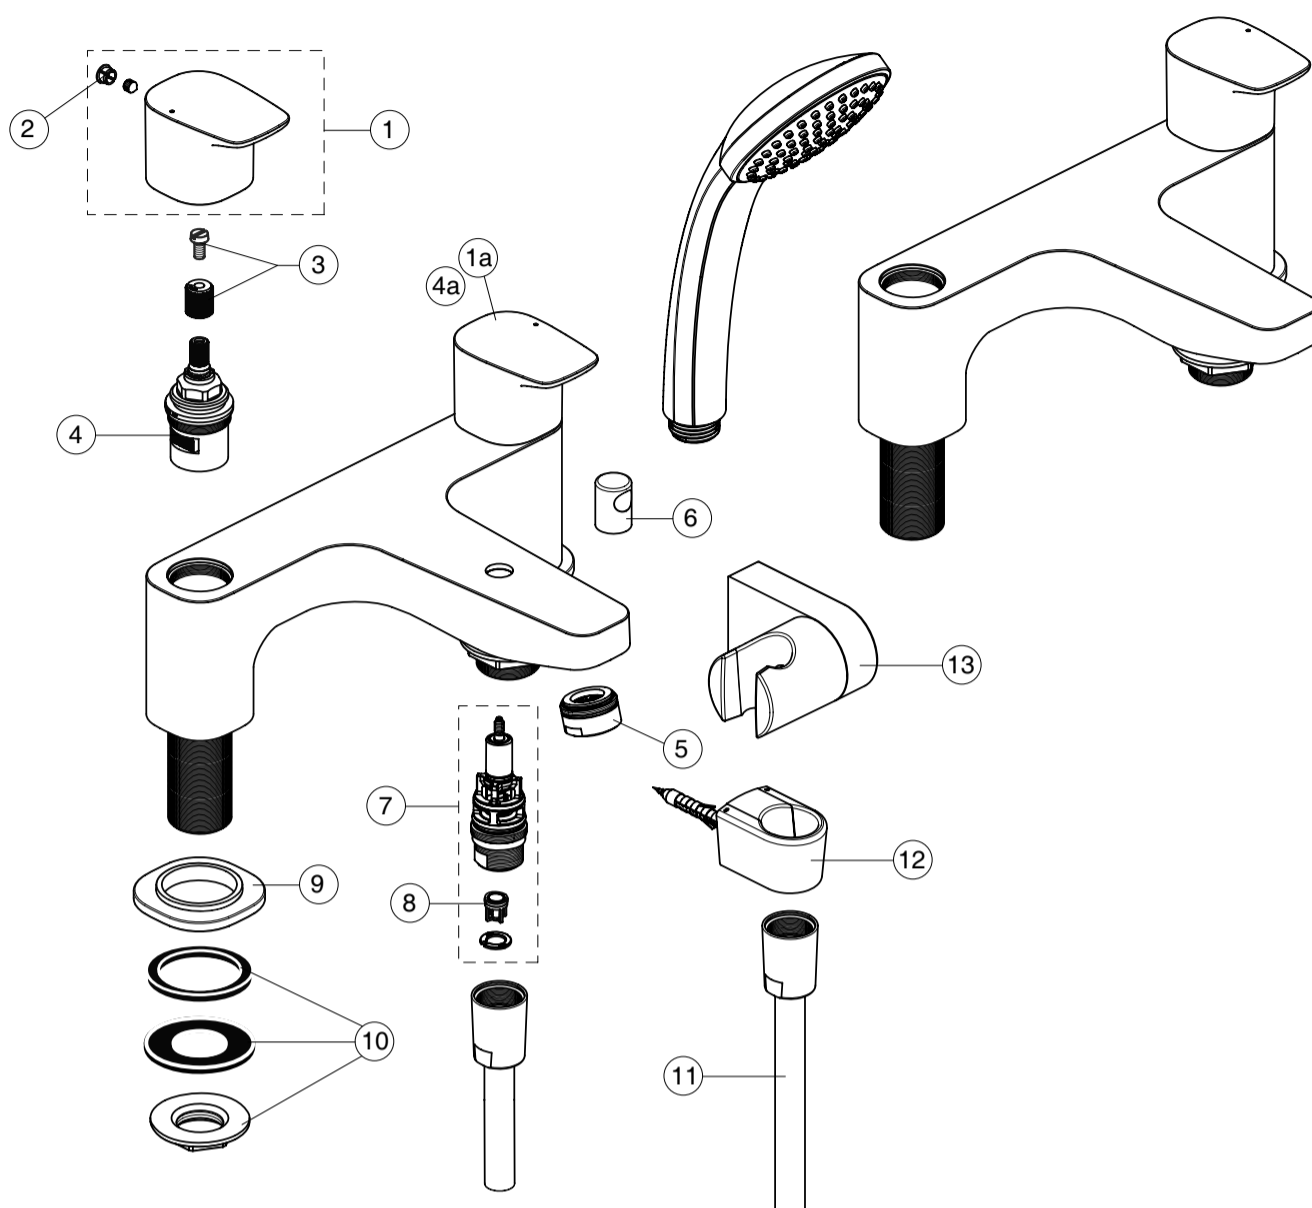



Ideal Standard

CERAPLAN


05.2021 / B565150

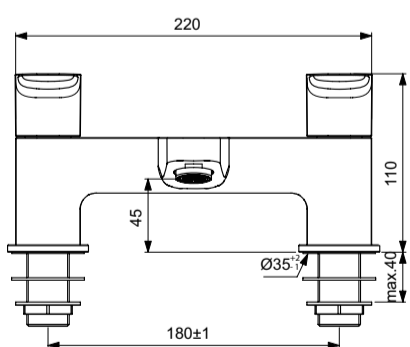


B D264 ..

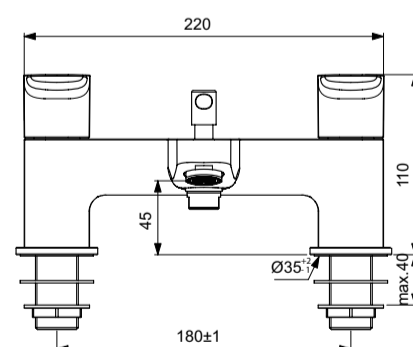
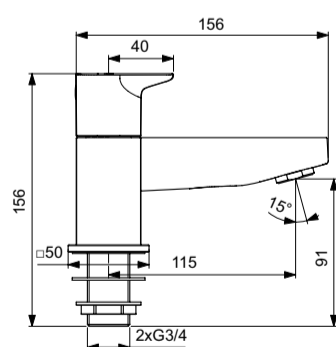


B D265 ..

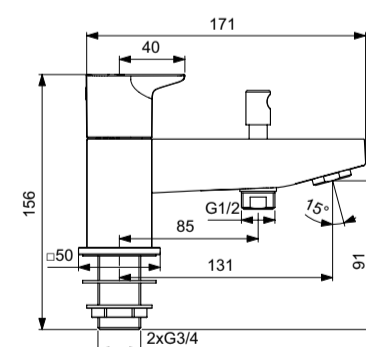

Ideal Standard International NV
Corporate Village – Gent Building
Da Vincilaan 2
1935 Zaventem
Belgium
<http://www.idealstandardinternational.com>



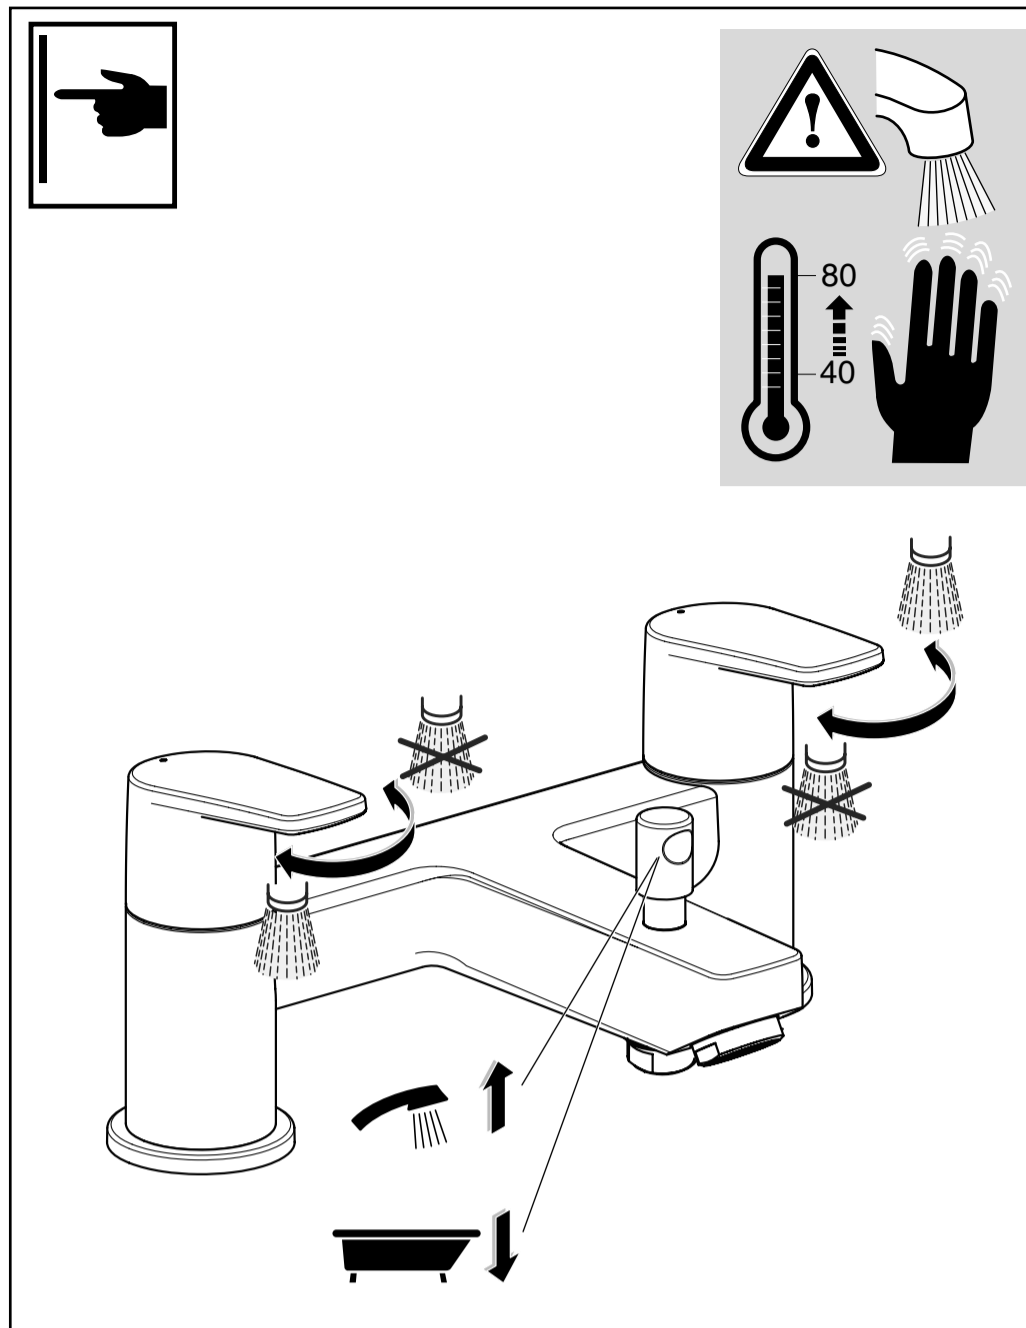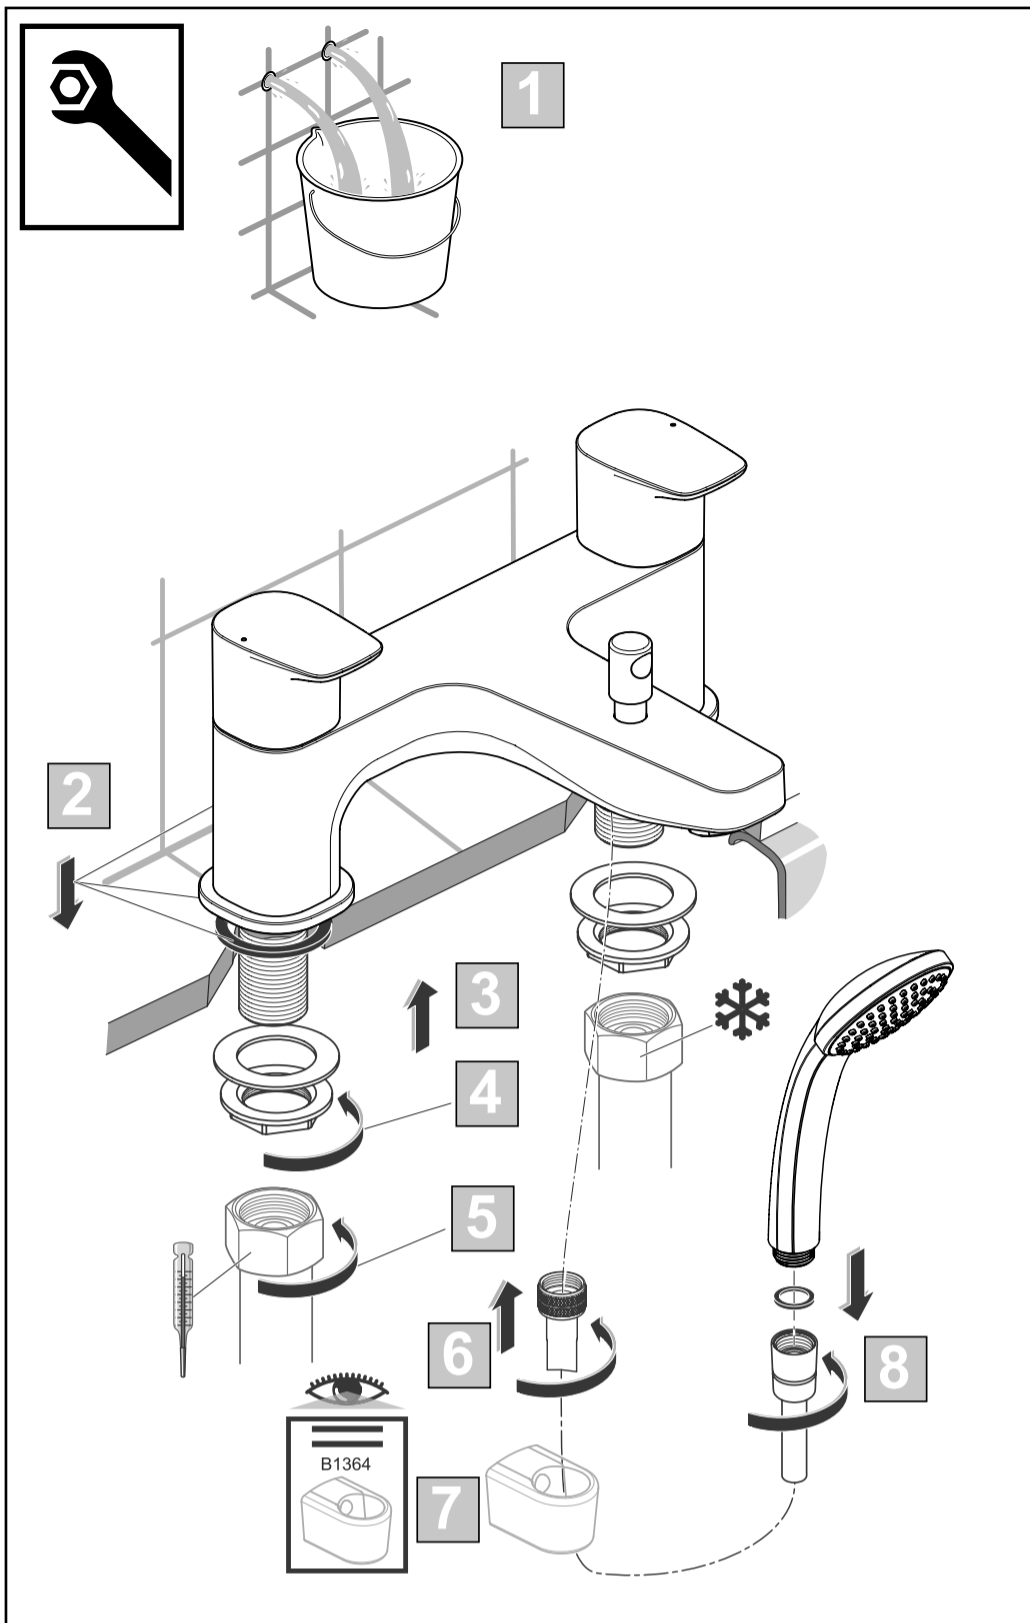

P	bar	MAX. 10	5		Q (0,2 bar)
T	°C	MAX. 80	65 40		11 13

